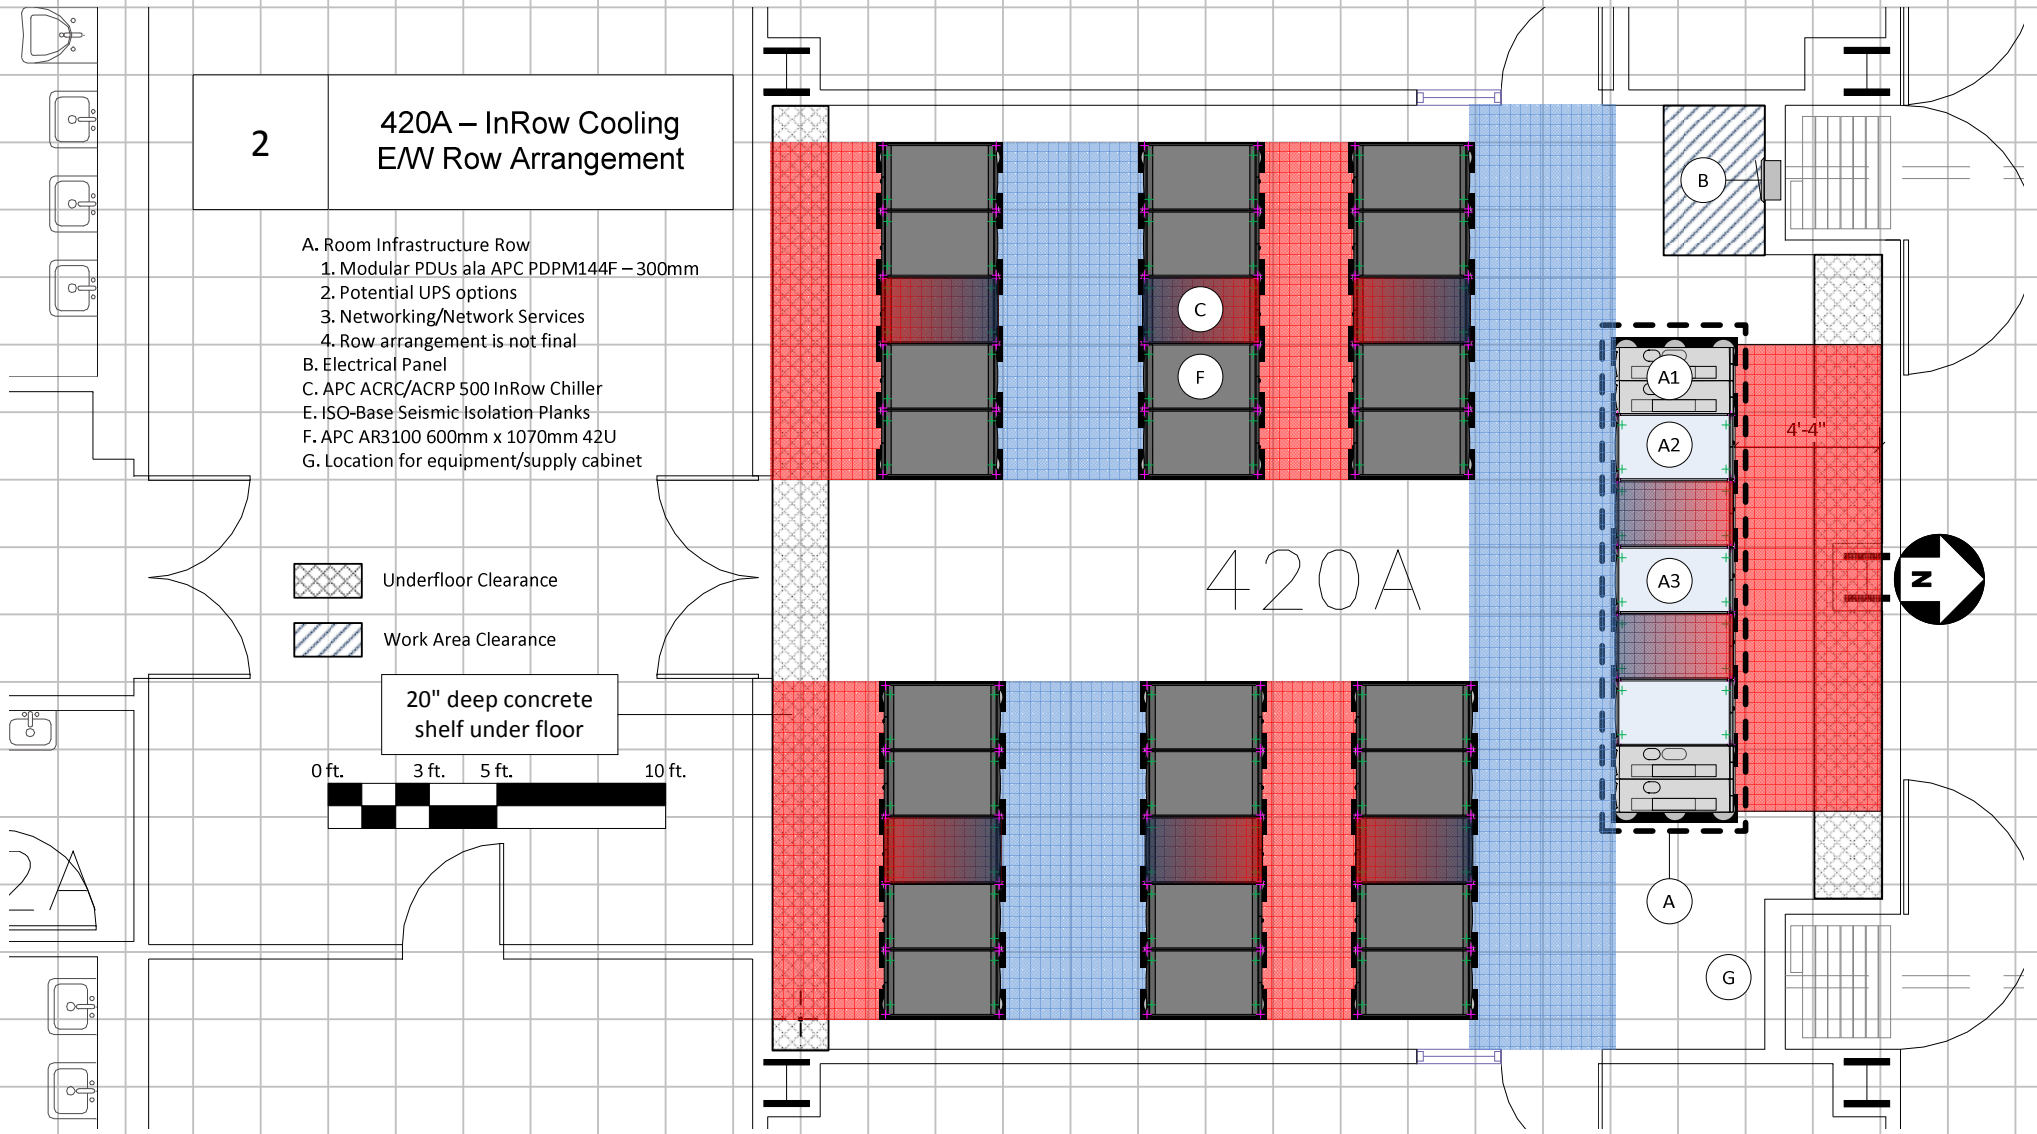
2
420A – InRow Cooling
E/W Row Arrangement
A. Room Infrastructure Row
1. Modular PDUs ala APC PDPM144F – 300mm
2. Potential UPS options
3. Networking/Network Services
4. Row arrangement is not final
B. Electrical Panel
C. APC ACRC/ACRP 500 InRow Chiller
E. ISO-Base Seismic Isolation Planks
F. APC AR3100 600mm x 1070mm 42U
G. Location for equipment/supply cabinet
Underfloor Clearance
Work Area Clearance
20" deep concrete shelf under floor
0 ft.
3 ft.
5 ft.
10 ft.
420A
A1
A2
A3
A
B
C
F
G
4'-4"
N