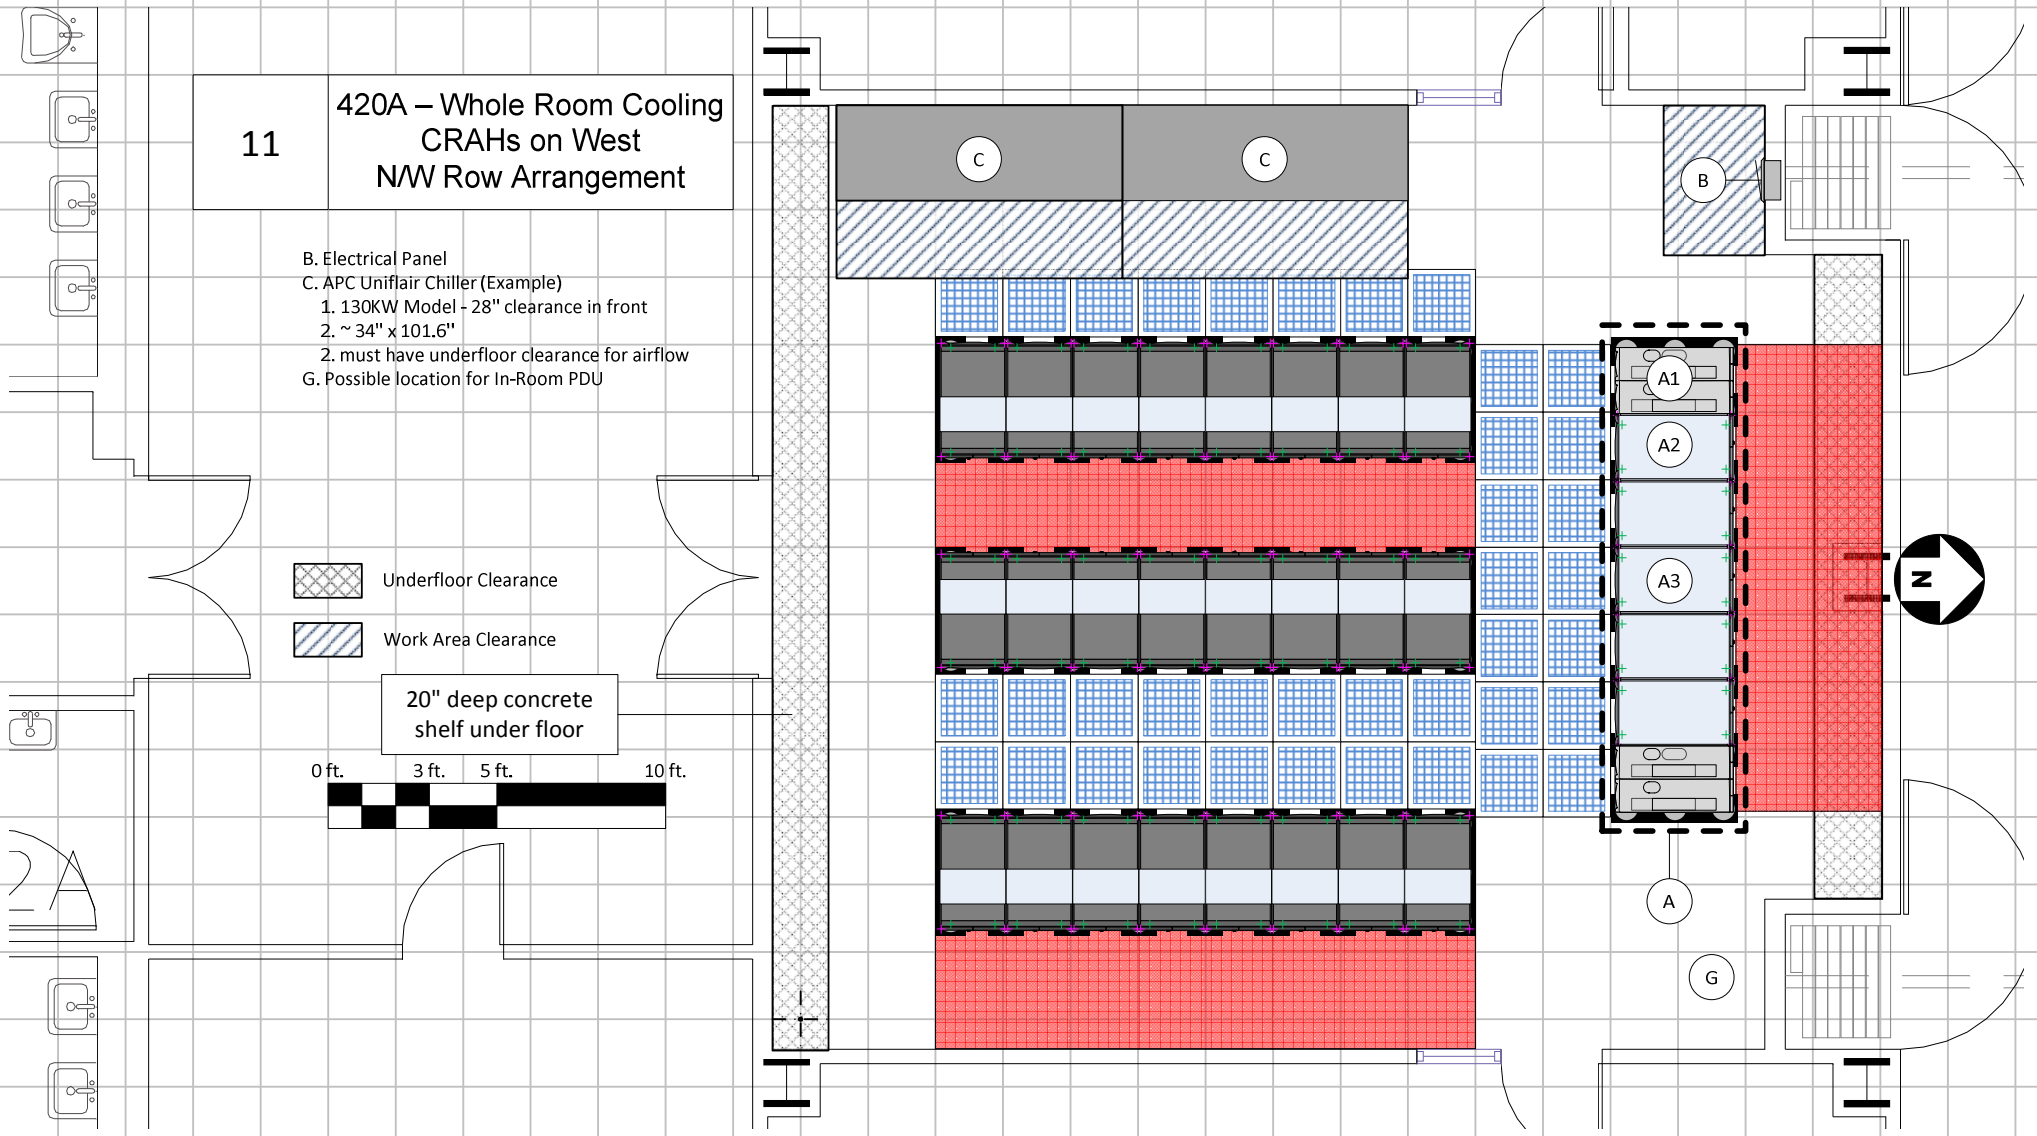
11
420A – Whole Room Cooling
CRAHs on West
N/W Row Arrangement
B. Electrical Panel
C. APC Uniflair Chiller (Example)
1. 130KW Model - 28" clearance in front
2. ~ 34" x 101.6"
2. must have underfloor clearance for airflow
G. Possible location for In-Room PDU
Underfloor Clearance
Work Area Clearance
20" deep concrete
shelf under floor
0 ft.
3 ft.
5 ft.
10 ft.
C
C
B
A1
A2
A3
A
G
N