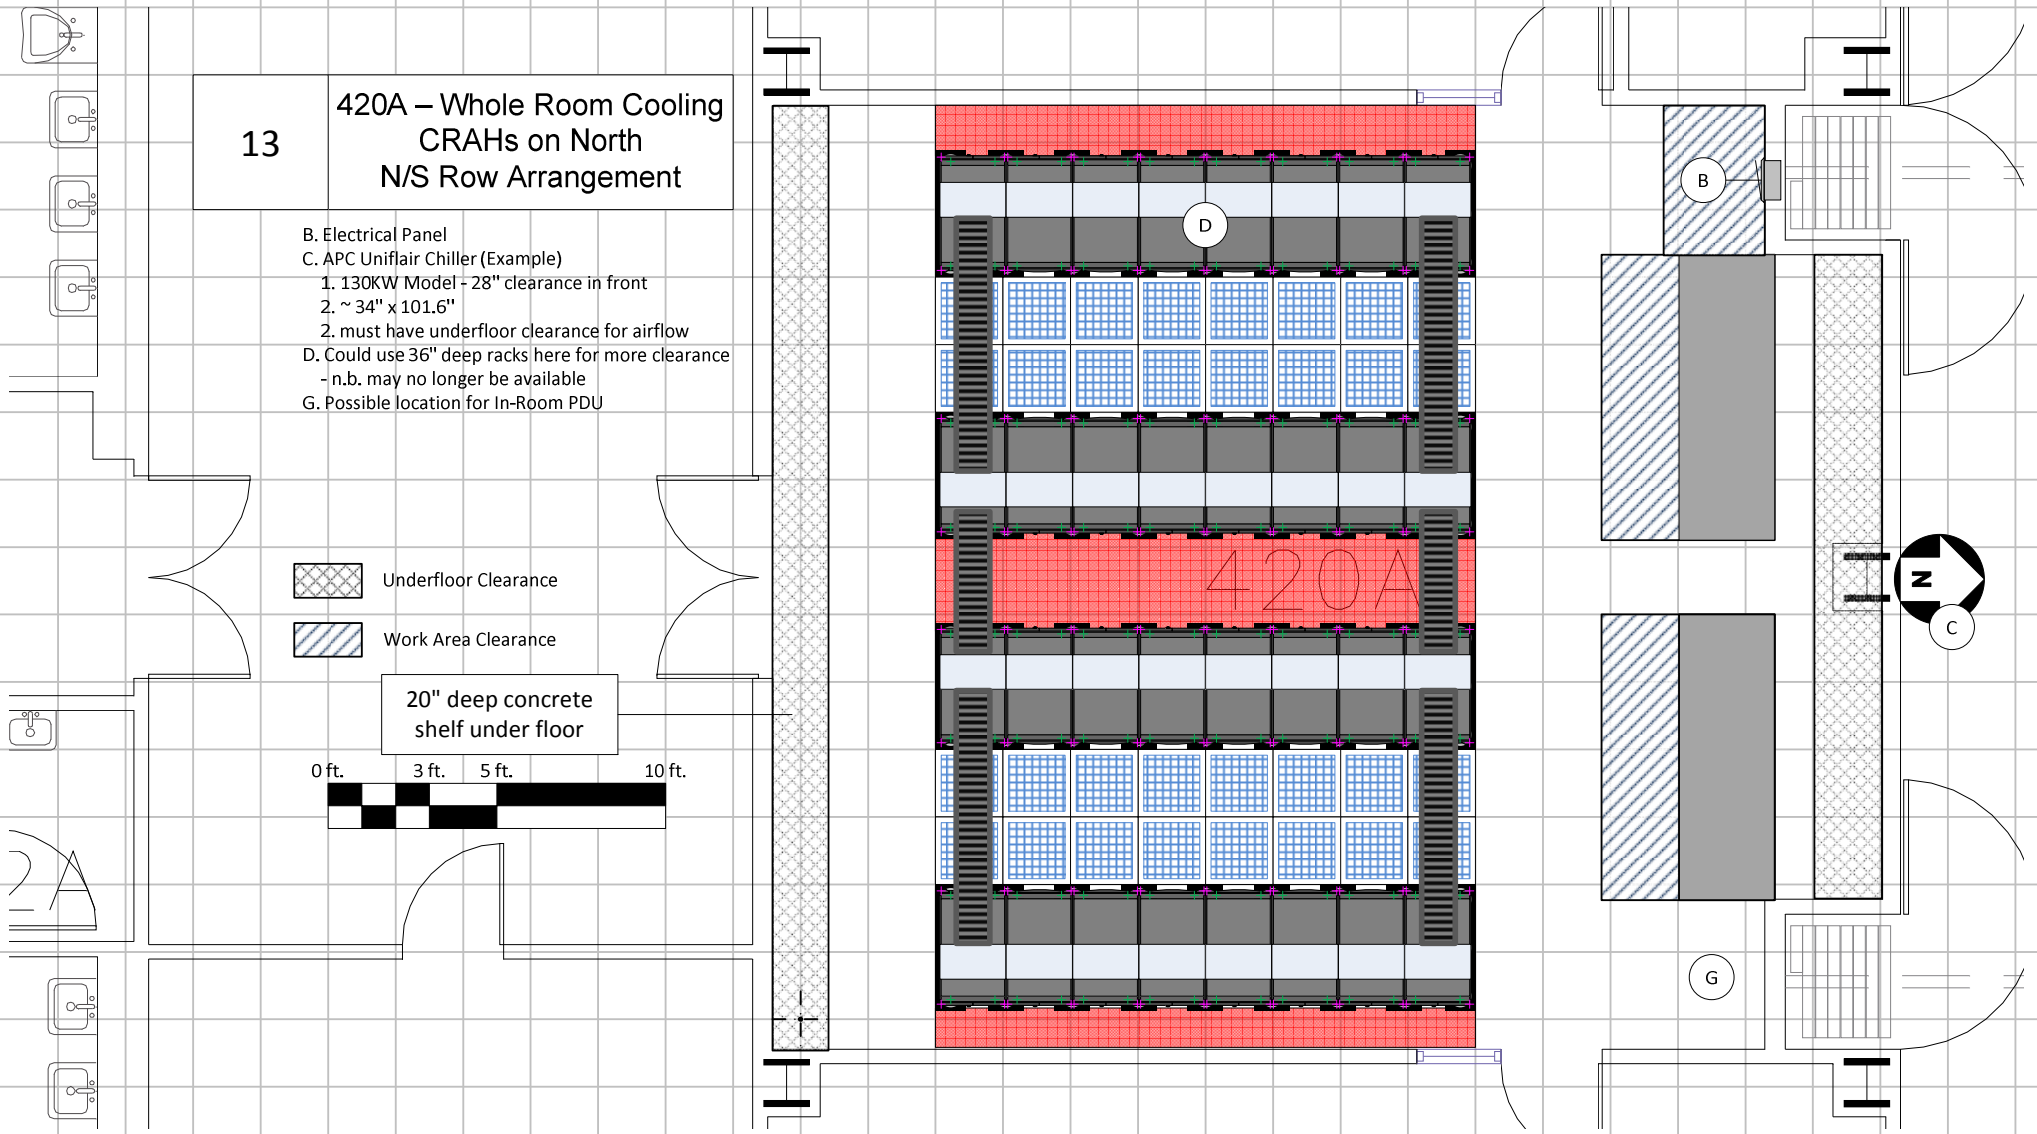
13
420A – Whole Room Cooling
CRAHs on North
N/S Row Arrangement
B. Electrical Panel
C. APC Uniflair Chiller (Example)
1. 130KW Model - 28" clearance in front
2. ~ 34" x 101.6"
2. must have underfloor clearance for airflow
D. Could use 36" deep racks here for more clearance
- n.b. may no longer be available
G. Possible location for In-Room PDU
Underfloor Clearance
Work Area Clearance
20" deep concrete
shelf under floor
0 ft.
3 ft.
5 ft.
10 ft.
D
420A
B
N
C
G