16	420A – Whole Room Cooling CRAHs on North, Move Panel E/W Row Arrangement

A. Infrastructure Row for
   1. Modular PDUs ala APC PDPM144F – 300mm
   2. UPS
   3. Network Aggregation/Services
   4. Other options/uses TBD
B. Electrical Panel
C. APC Uniflair Chiller (Example)
   1. 130KW Model - 28" clearance in front
   2. ~ 34" x 101.6"
   2. must have underfloor clearance for airflow
F. APC AR3100 600mm x 1070mm 42U
G. APC AR8561 Cable Troughs

Underfloor Clearance

Work Area Clearance

20" deep concrete shelf under floor
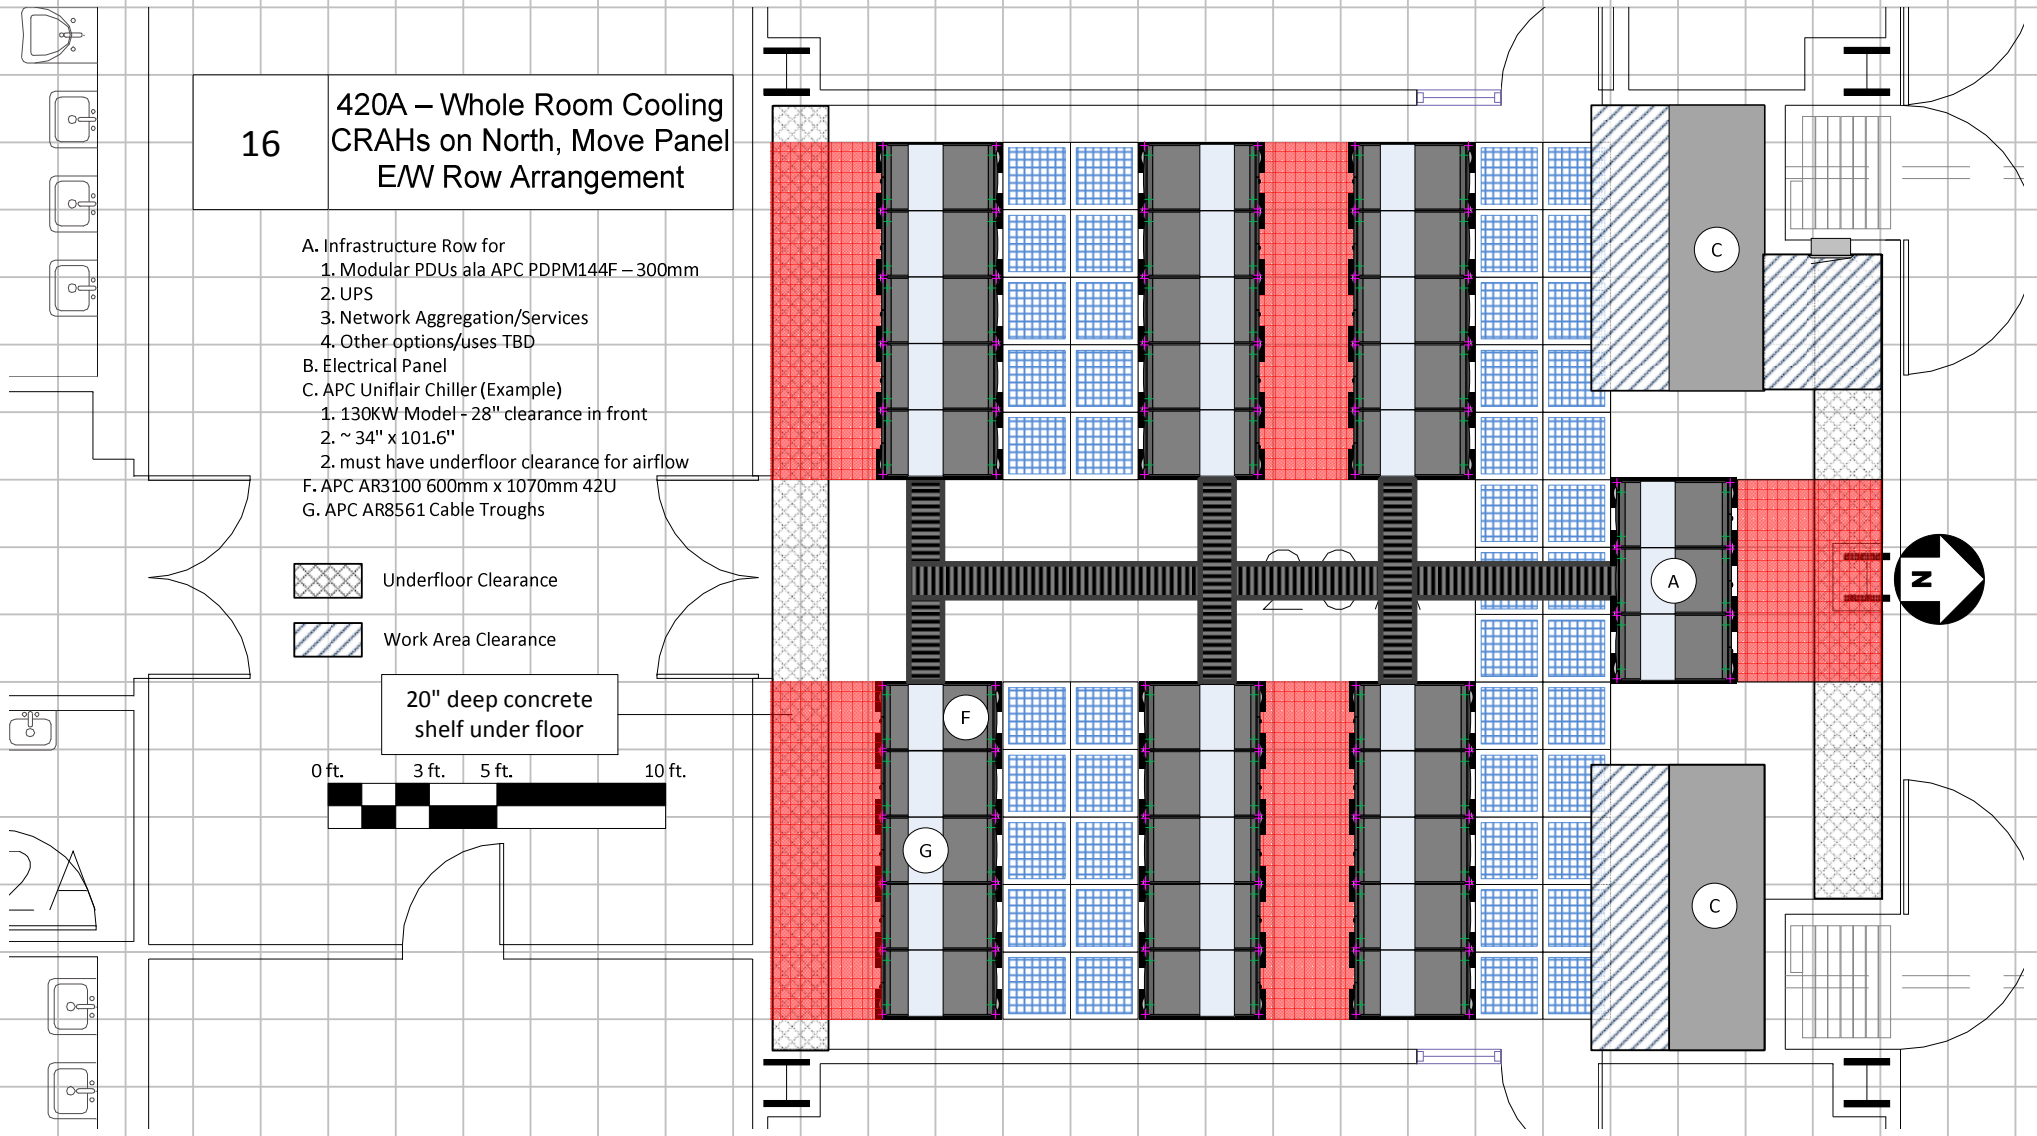
0 ft. 3 ft. 5 ft. 10 ft.